

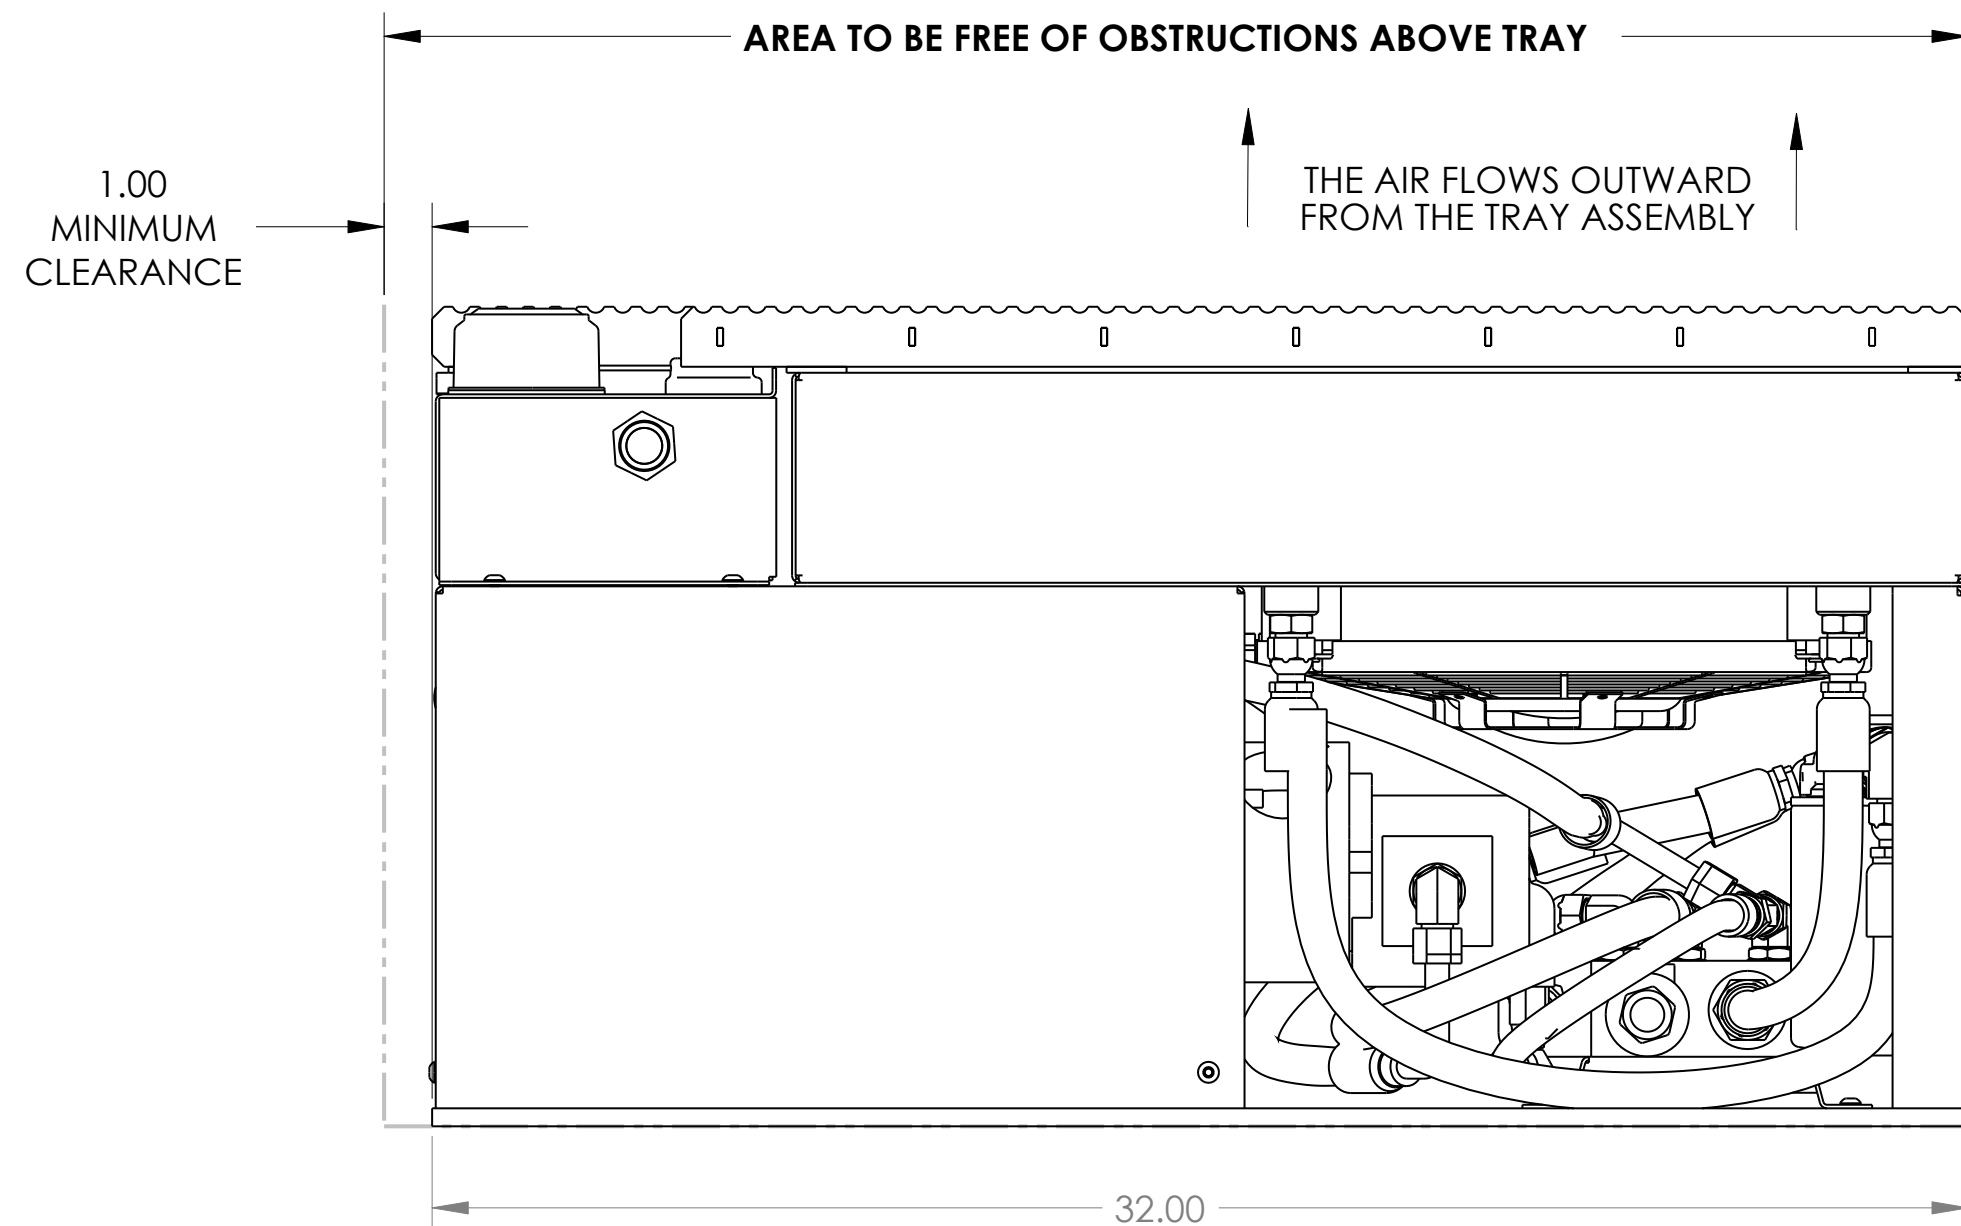
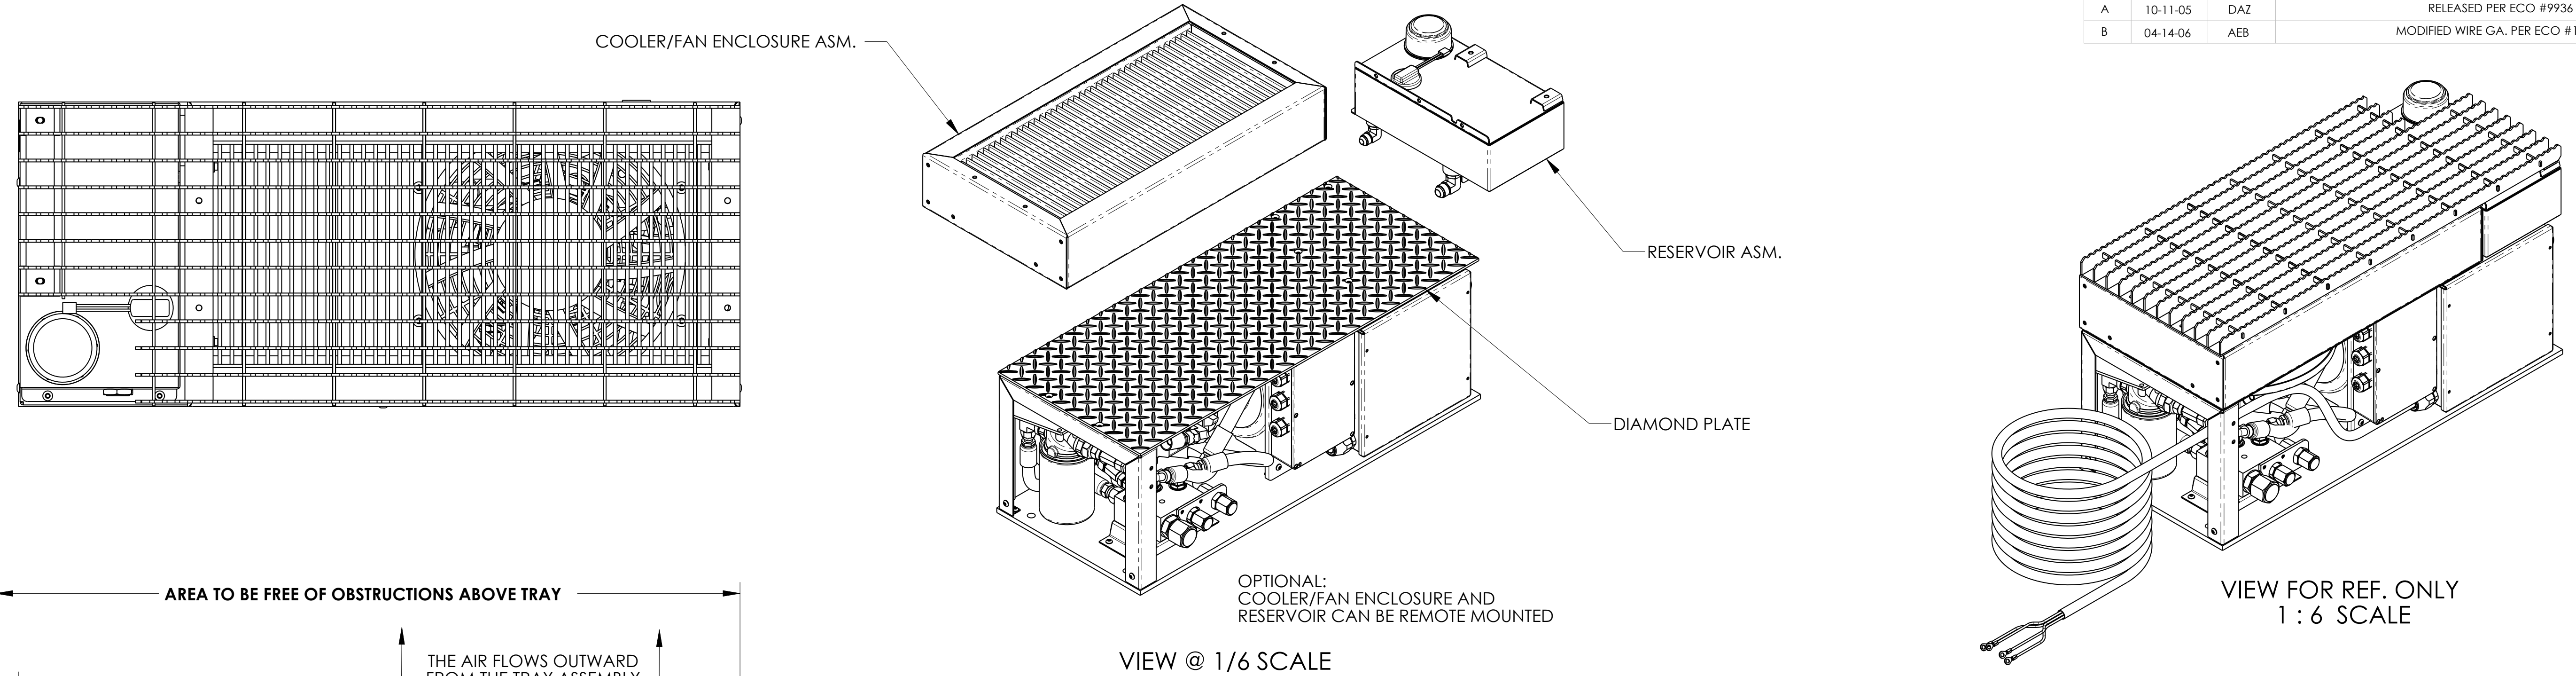
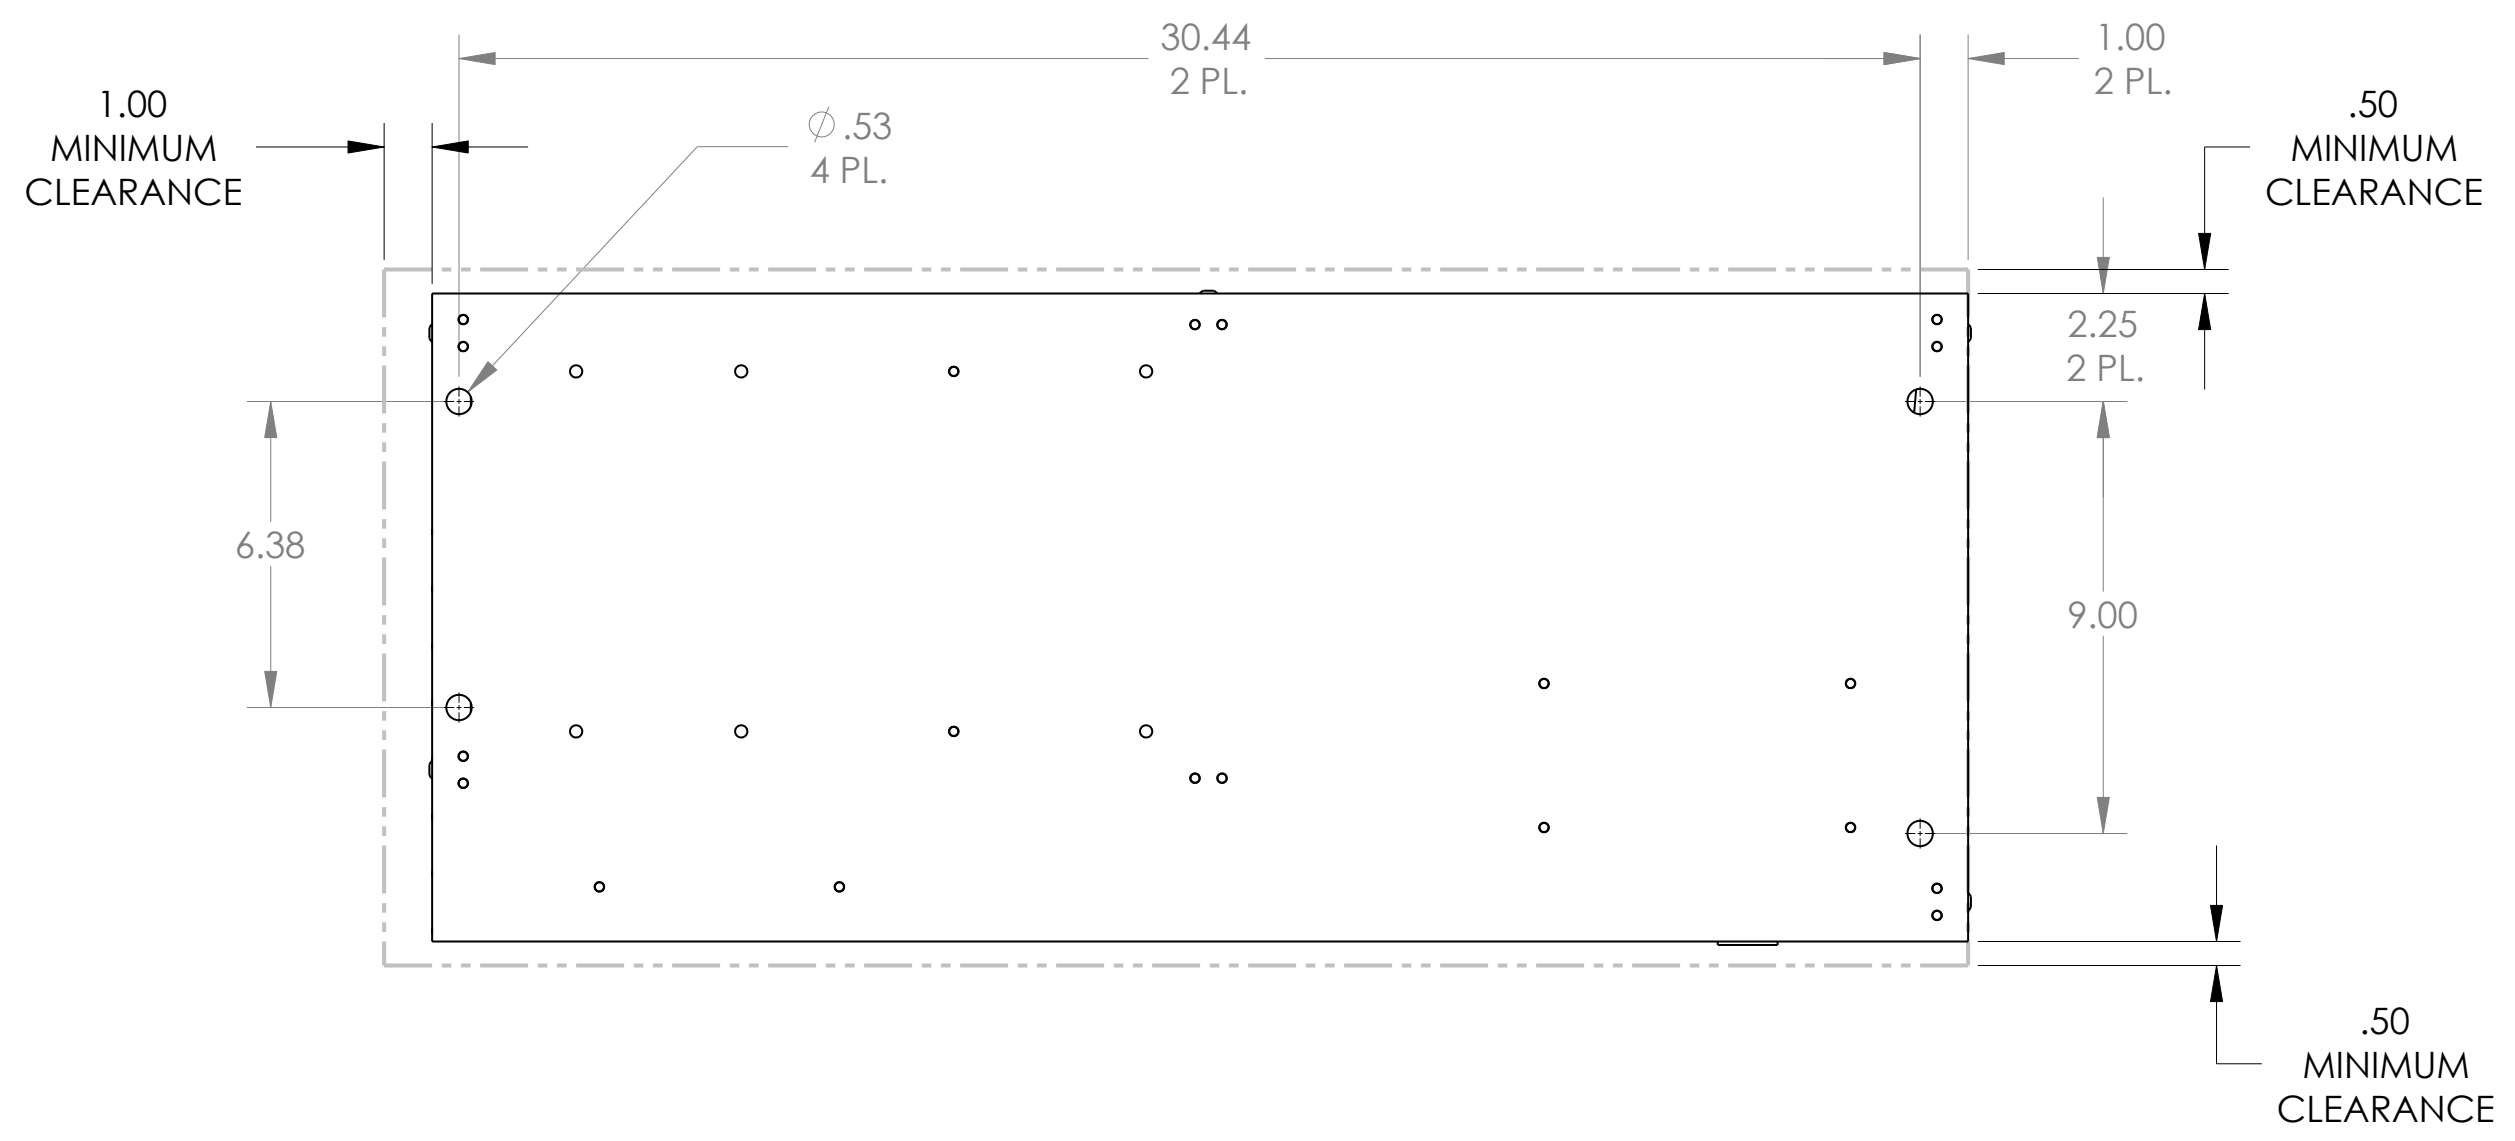


REV	DATE	BY	DESCRIPTION
A	10-11-05	DAZ	RELEASED PER ECO #9936
B	04-14-06	AEB	MODIFIED WIRE GA. PER ECO #10008

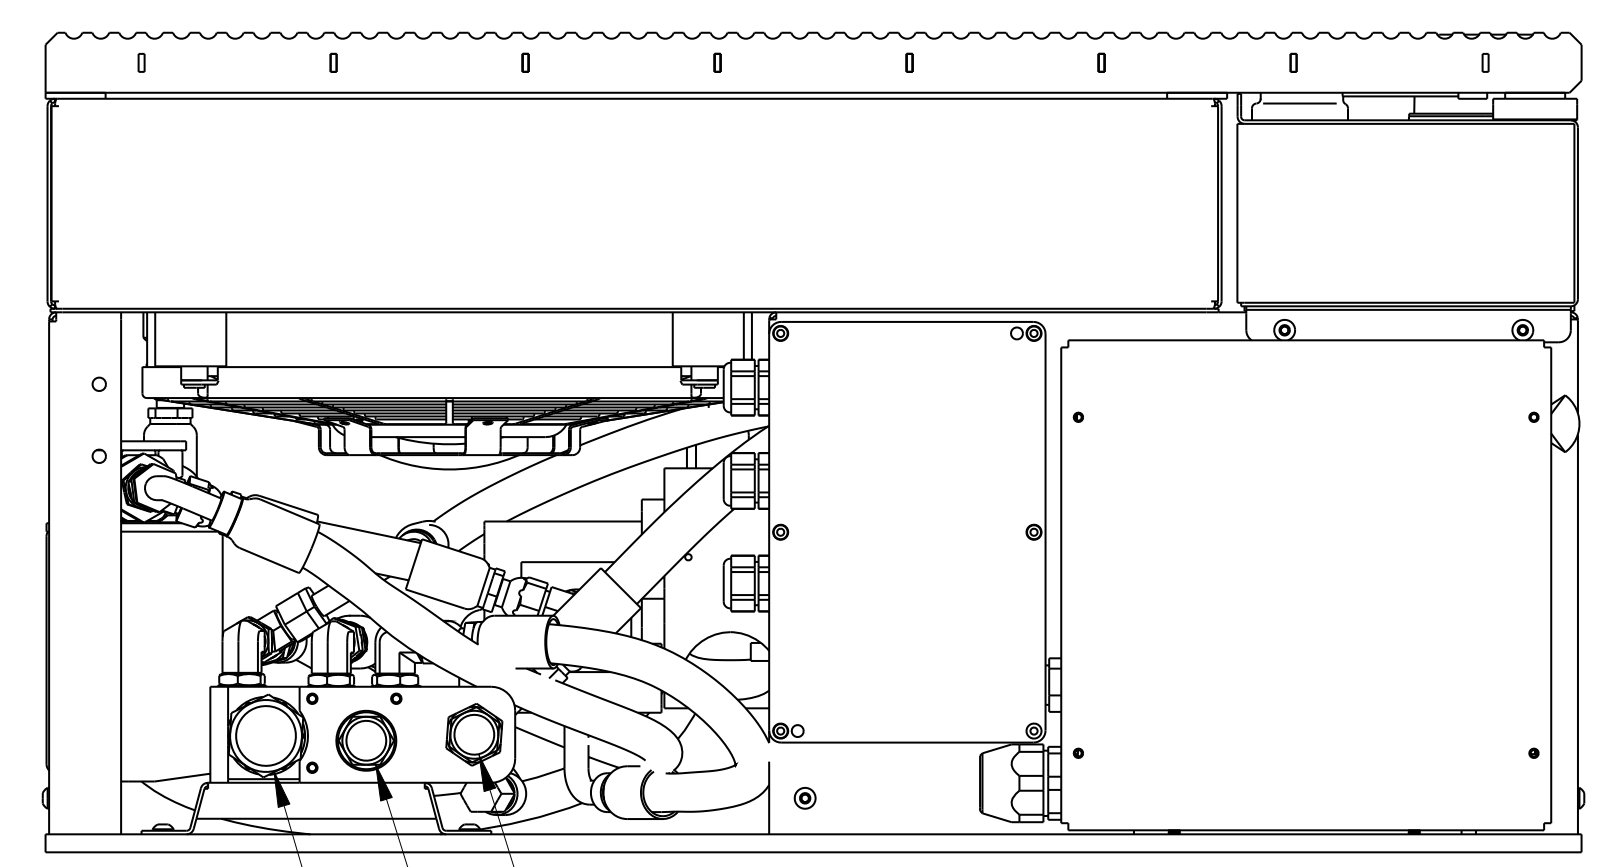

10" X 10" OPENING FOR FRESH AIR IN

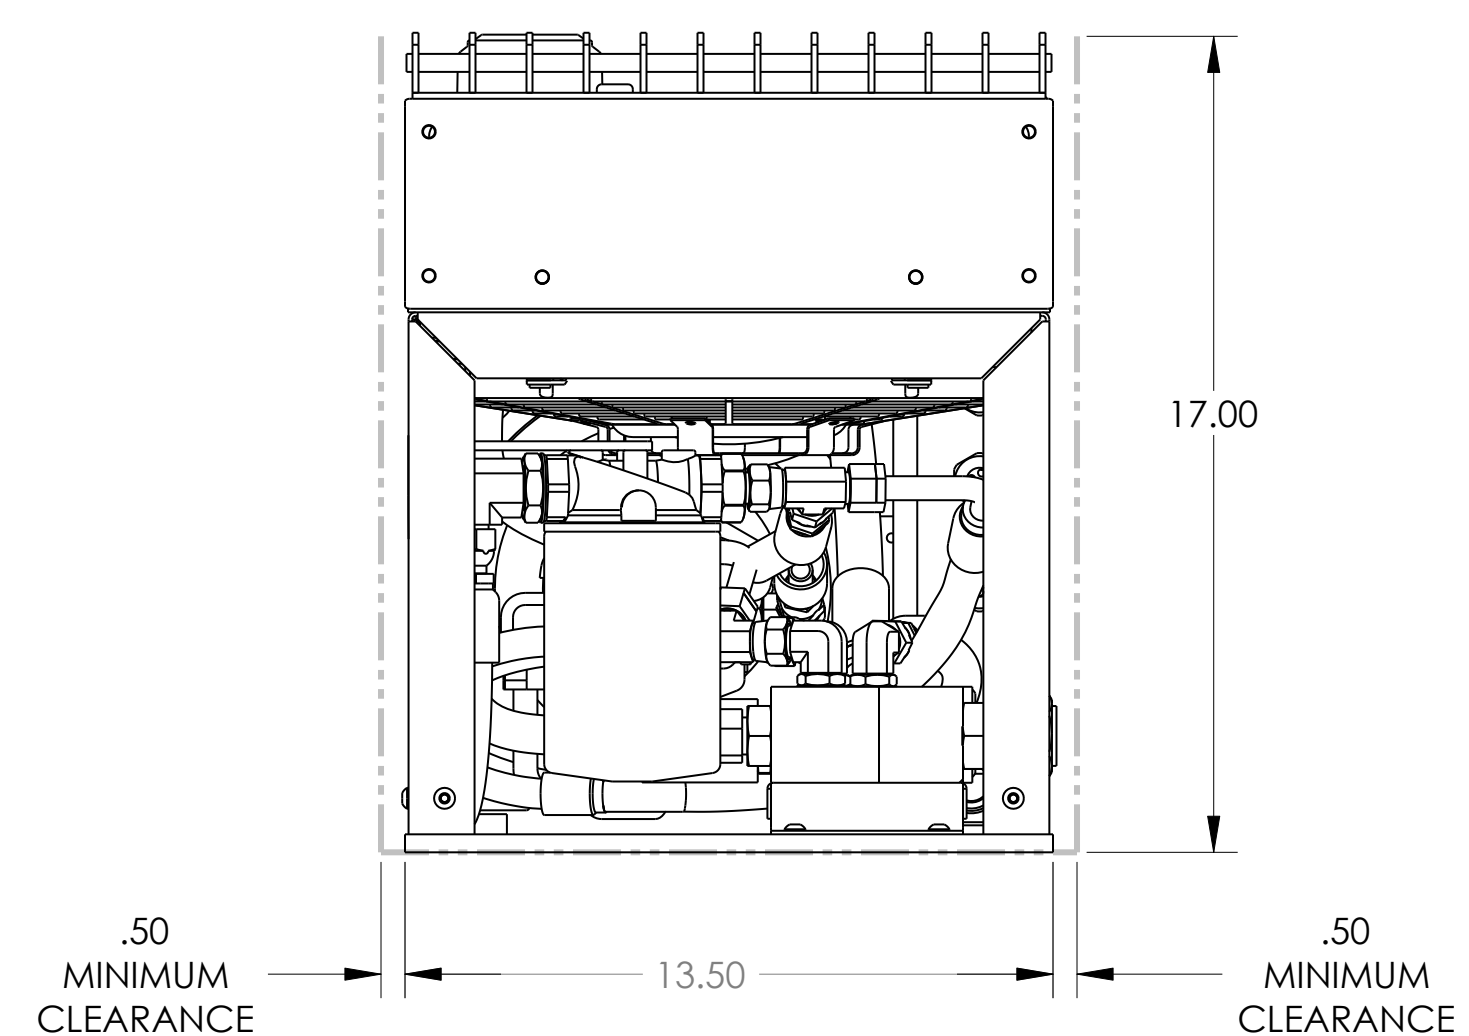

- NOTE:
1. ASSEMBLY IS 100% PRODUCTION TESTED
  2. DIMENSION TOLERANCE : ±0.03
  3. RESERVOIR ASSEMBLY CAN BE REMOVED FROM FRAME ASSEMBLY AND REMOTELY MOUNTED
  4. TRAY ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
  5. GENERATOR OUTPUT WIRE ASSEMBLY: 15FT ± 1FT LONG  
GREEN WIRE, 8AWG - GROUND  
WHITE WIRE, 8AWG - NEUTRAL  
BLACK WIRE, 8AWG - 240V, L1  
RED WIRE, 8AWG - 240V, L2  
CONDUIT, (FNMC)
  6. REF. DRAWING 26XXXXX MODEL MATRIX FOR SYSTEM DETAILS

**PROPRIETARY DATA**  
STRICTLY CONFIDENTIAL  
**NARTRON**  
CORPORATION

**SW** COMPUTER GRAPHICS  
NO HAND REVISIONS

THIS DOCUMENT IS THE PROPERTY OF NARTRON CORPORATION AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.

DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

**SPECIFICATION CONTROL DRAWING**

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
DAZ	08-05-05				DO NOT SCALE
CHECKED	DATE				DIMENSIONS ARE IN INCHES
AEB	10-12-05				
APPROVED	DATE				TOLERANCE UNLESS OTHERWISE SPECIFIED
PHS	10-12-05				
MATERIAL					2 PLACE DECIMALS ±0.01
					3 PLACE DECIMALS ±0.005
NEXT ASSEMBLY					ANGLES ±1/2°
					THDS. INT 2B EXT 2A

NAME	NO
ELECTRONIC CONTROL TRAY ASM, 10-KW TOP MOUNT	8583040

REED CITY, MI 49677

SCALE 1/4 SIZE

SHEET 1 OF 1