

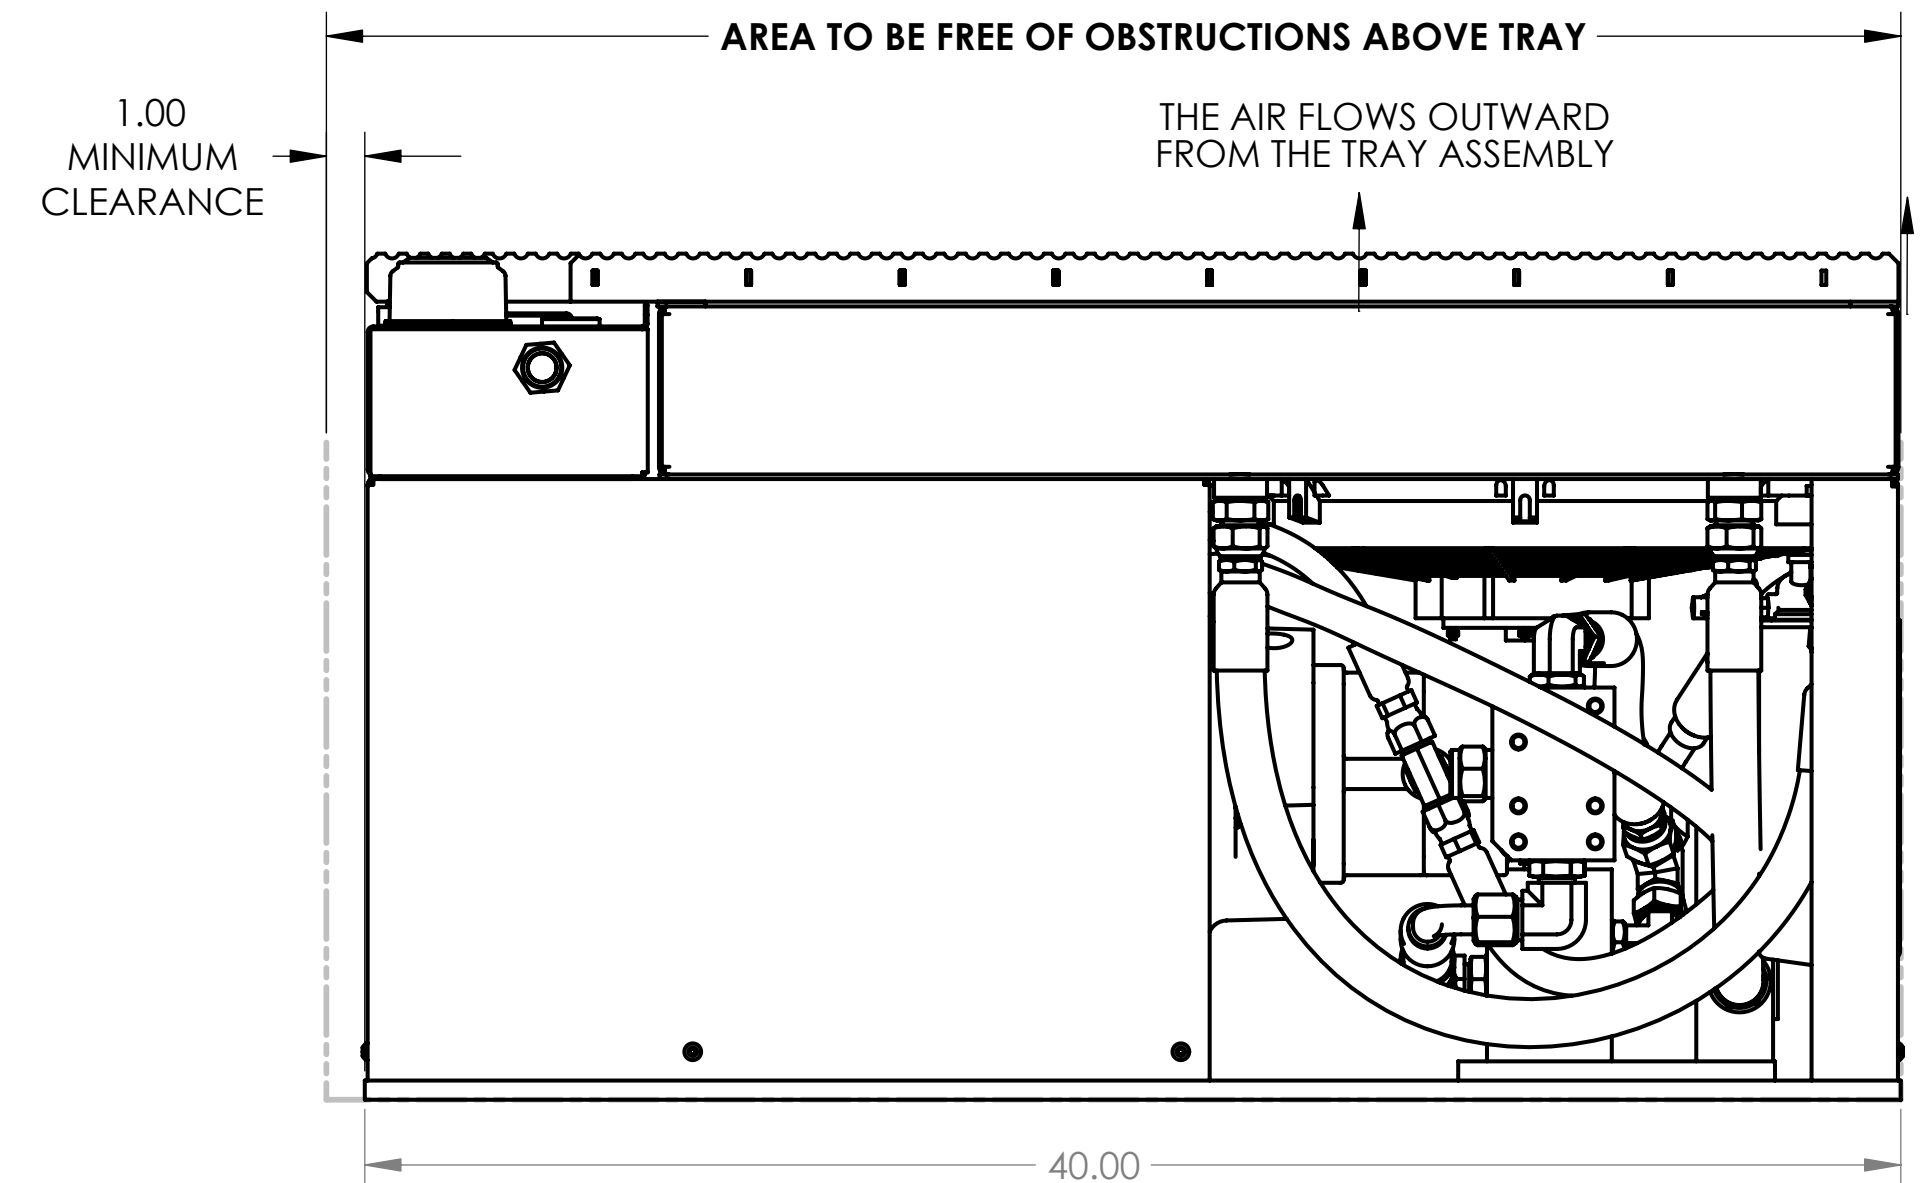
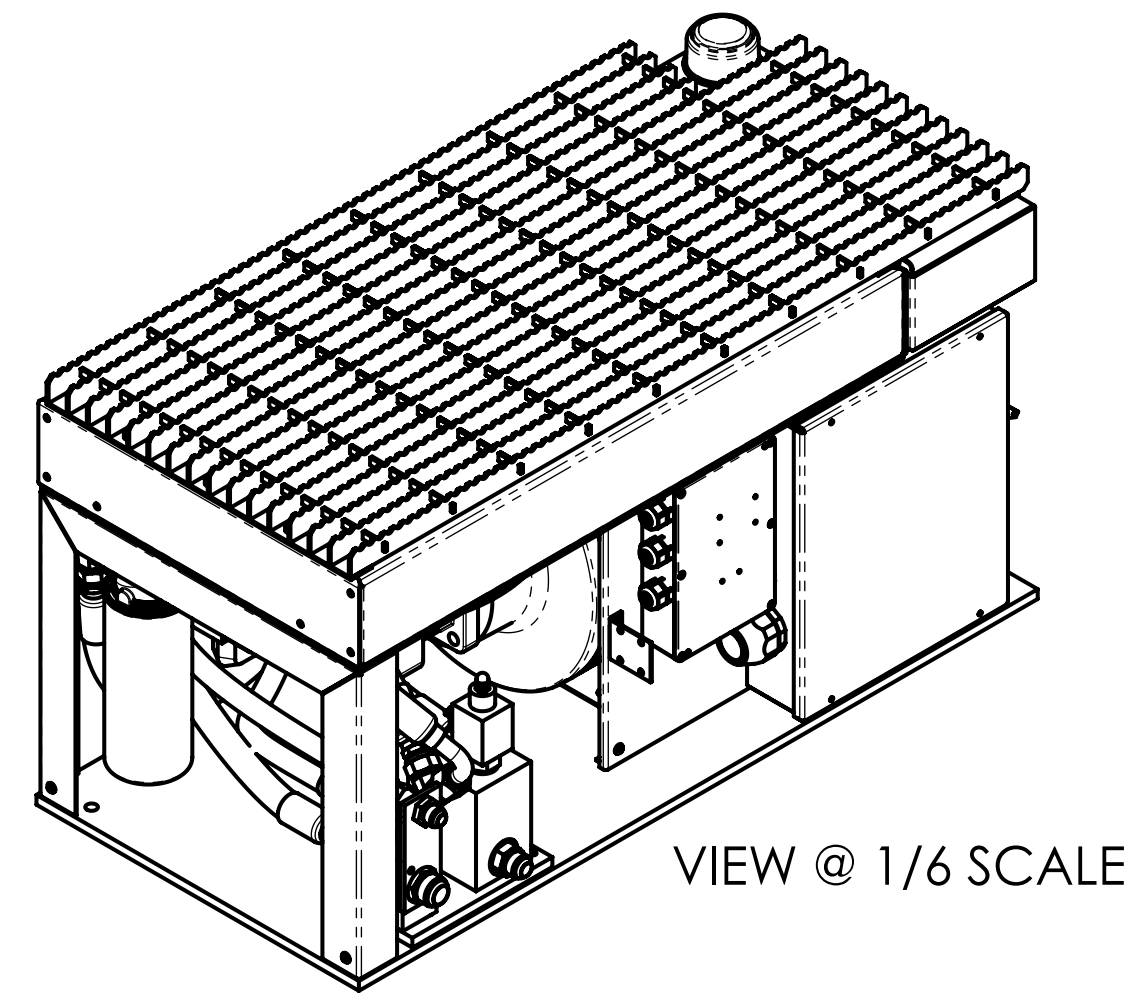
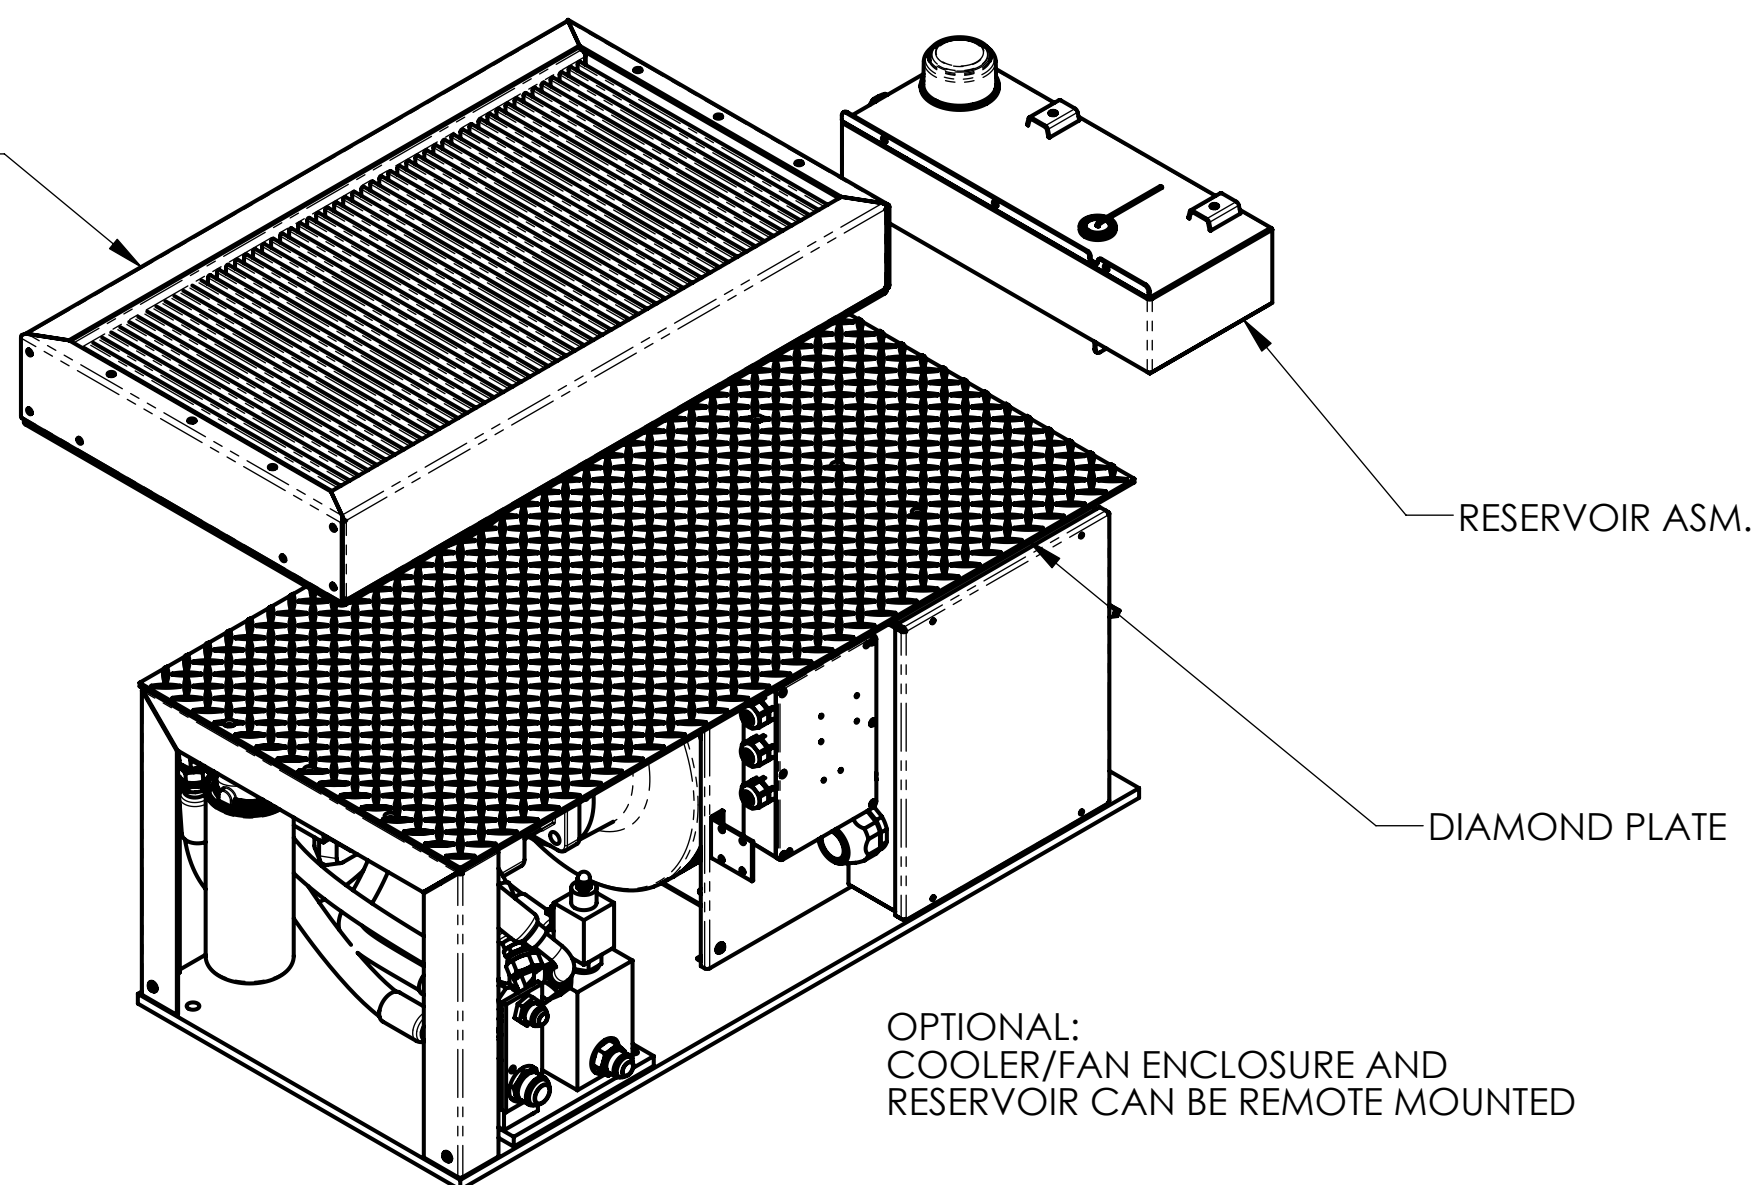
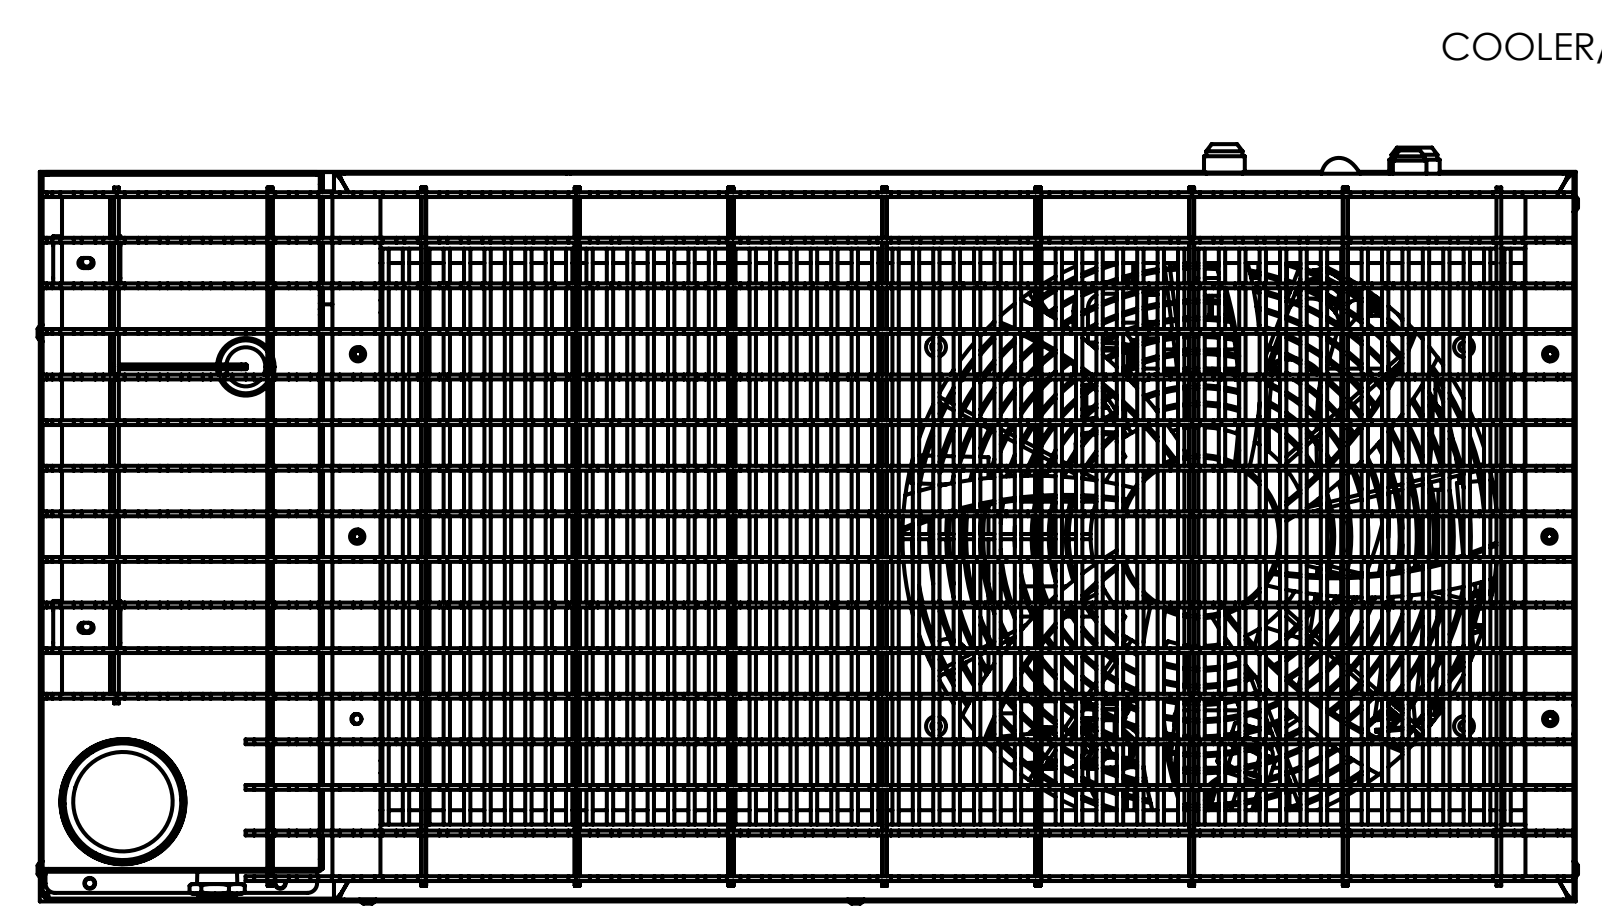
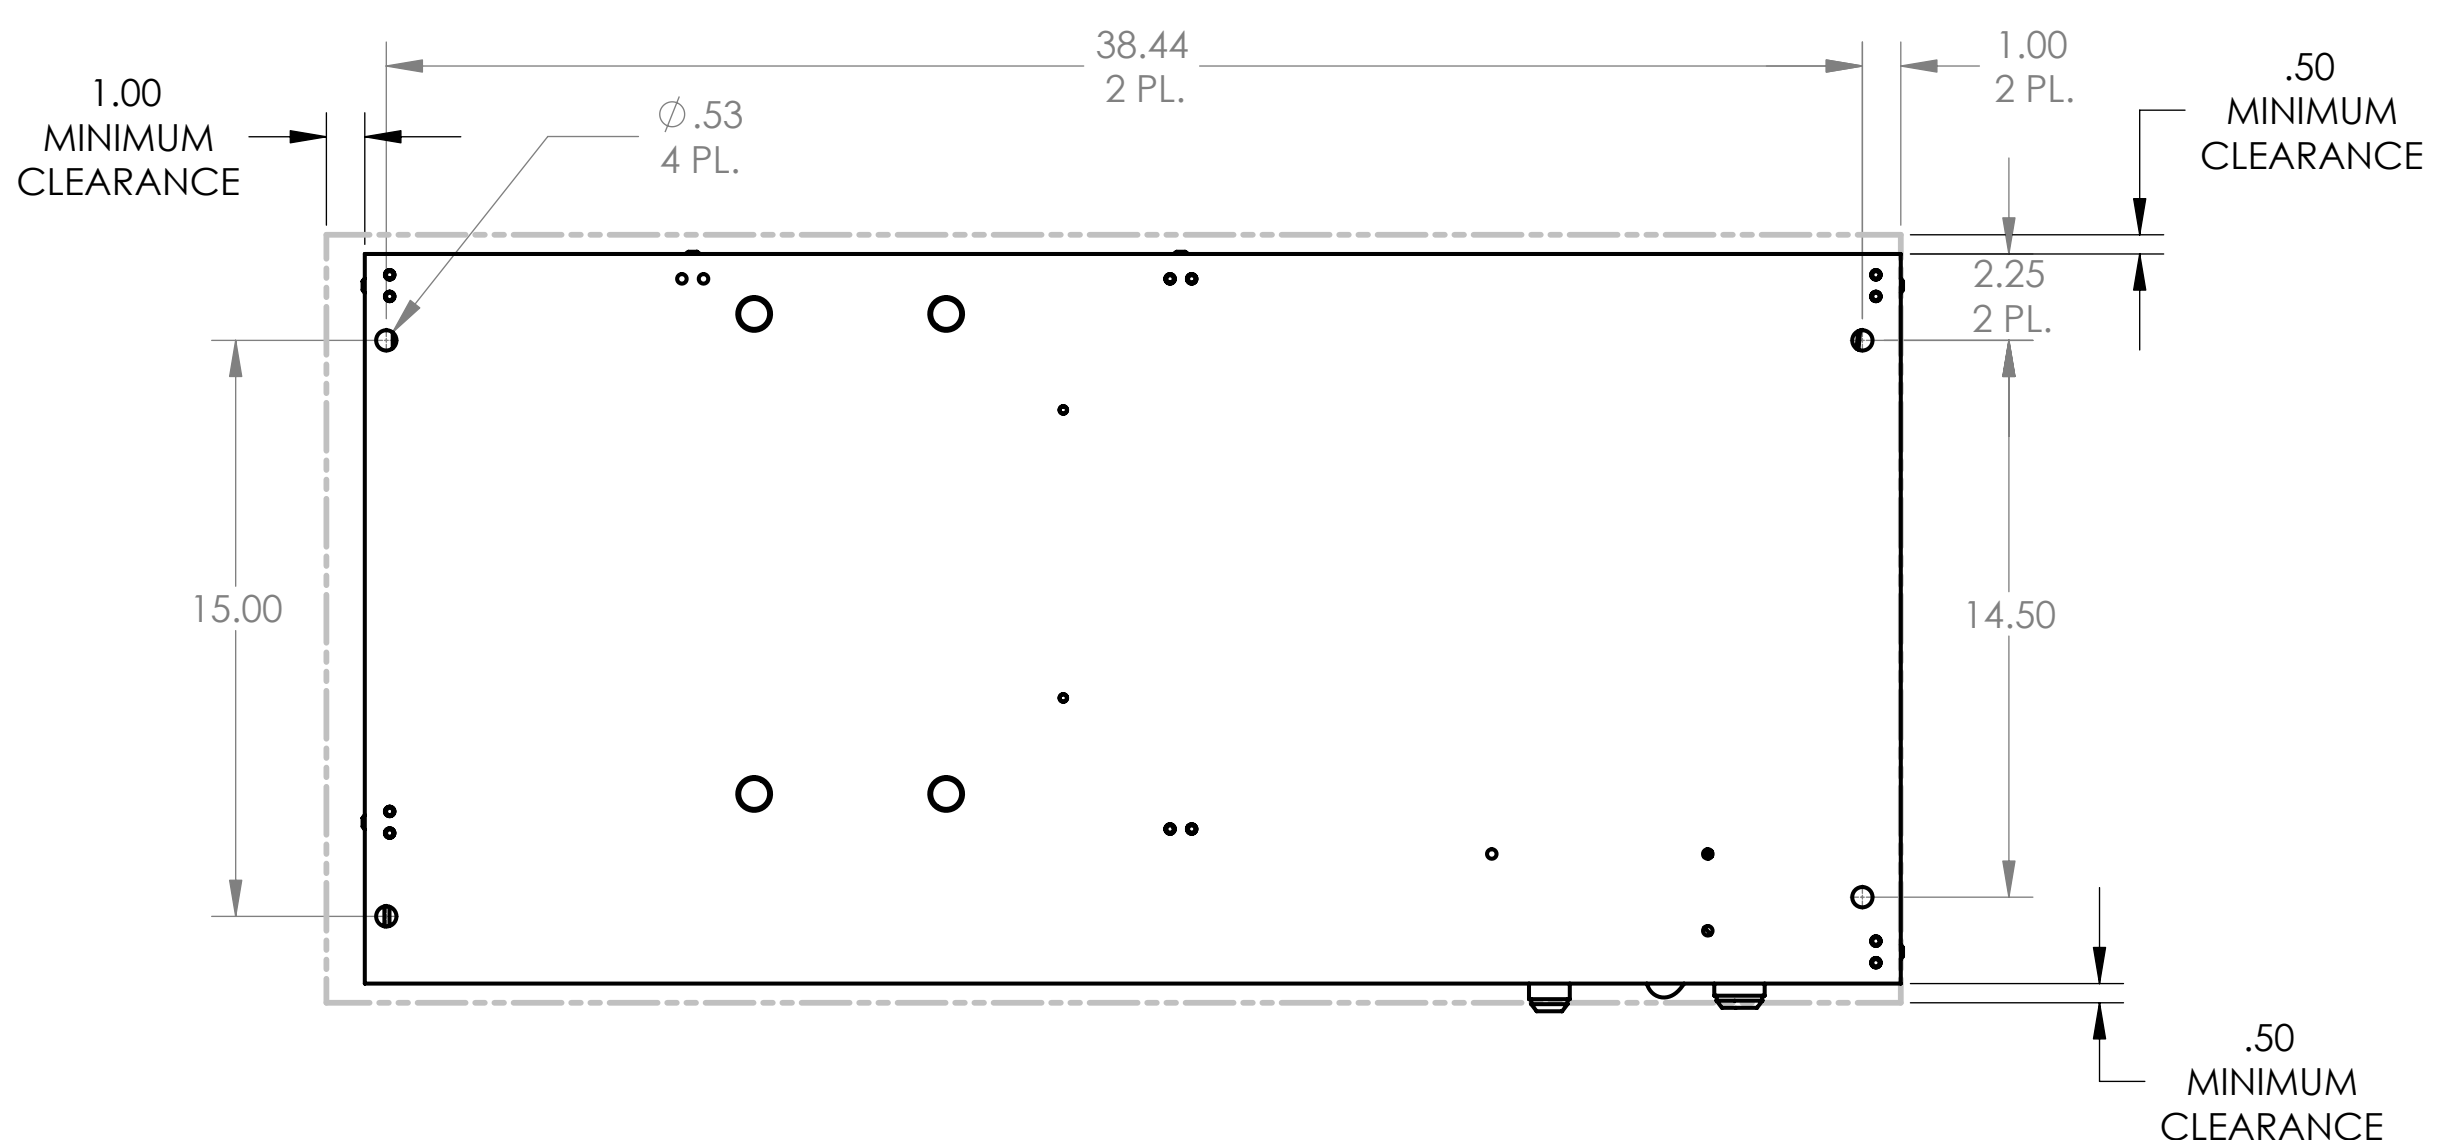


REV	DATE	BY	DESCRIPTION
A	06-06-06	BMB	RELEASED PER ECO #10062
B	09-25-06	BMB	REVISED 10AWG WIRES TO 2AWG WIRES PER ECO #10115

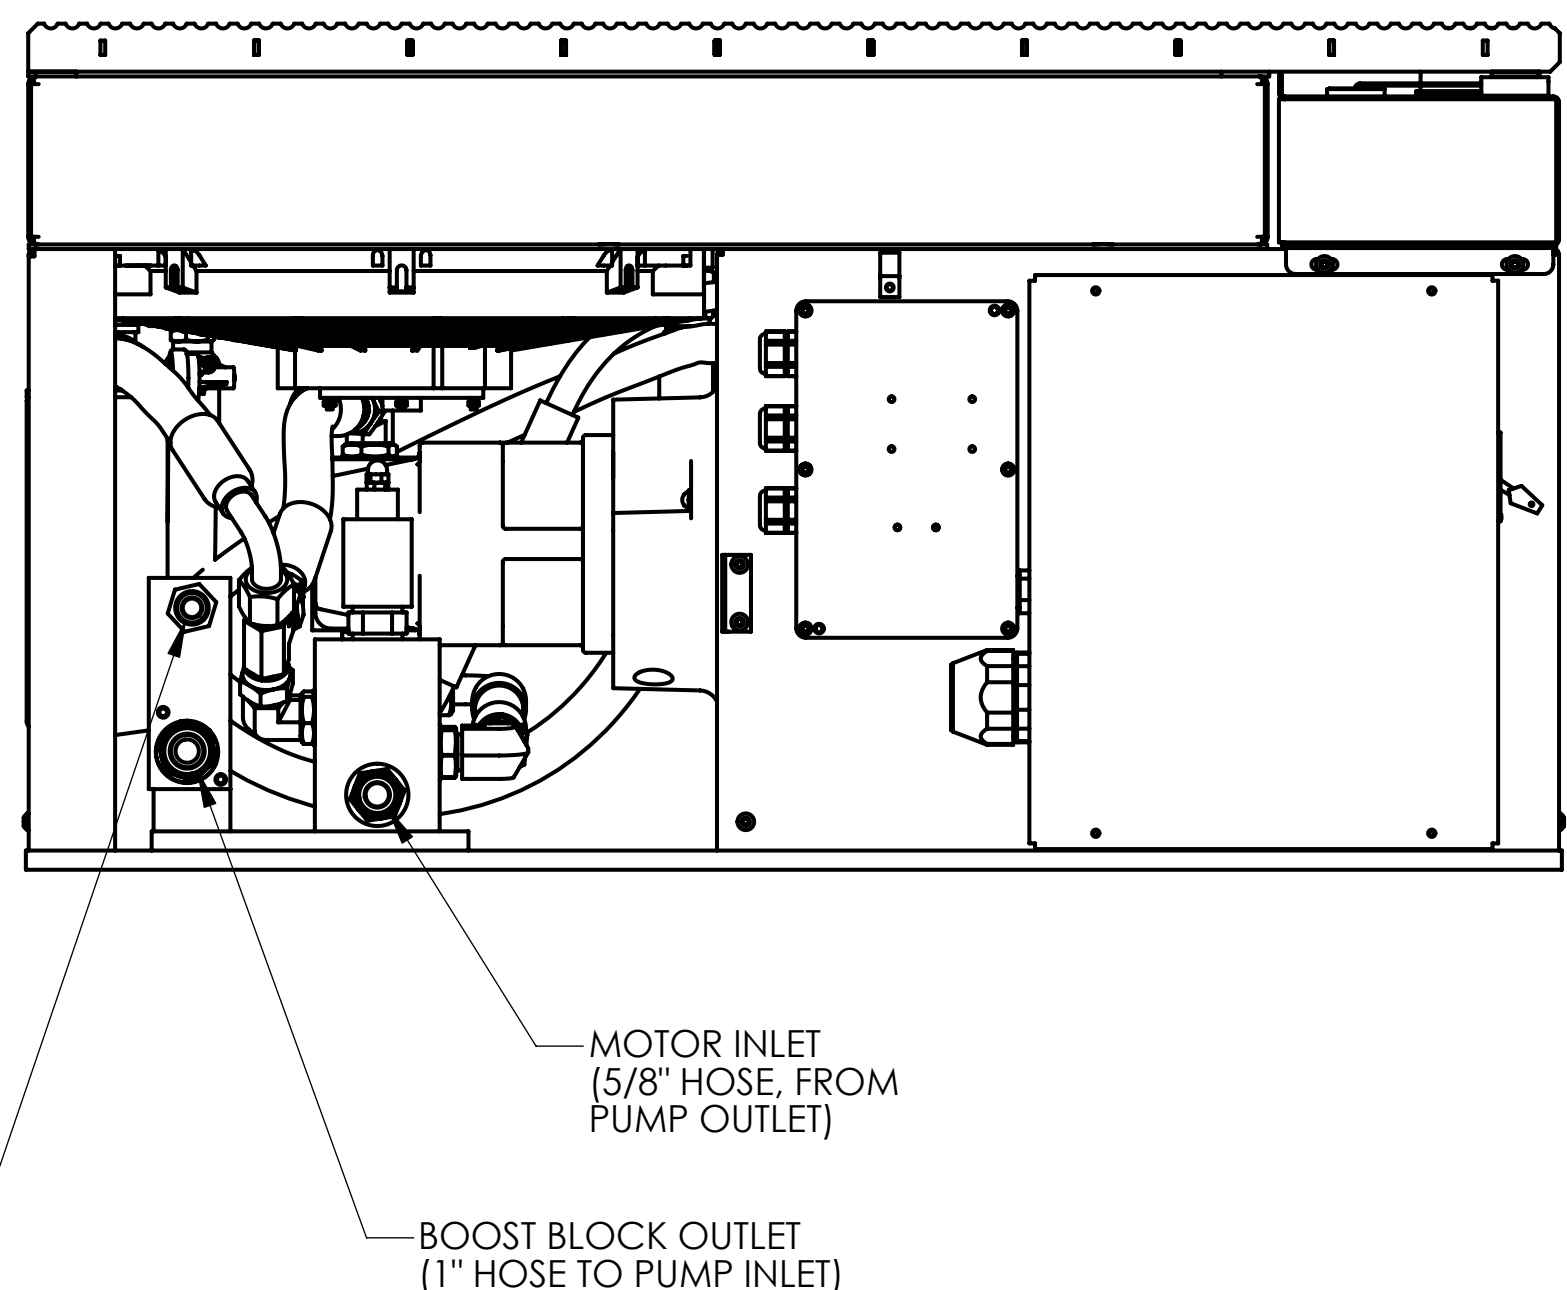

VIEW @ 1/6 SCALE

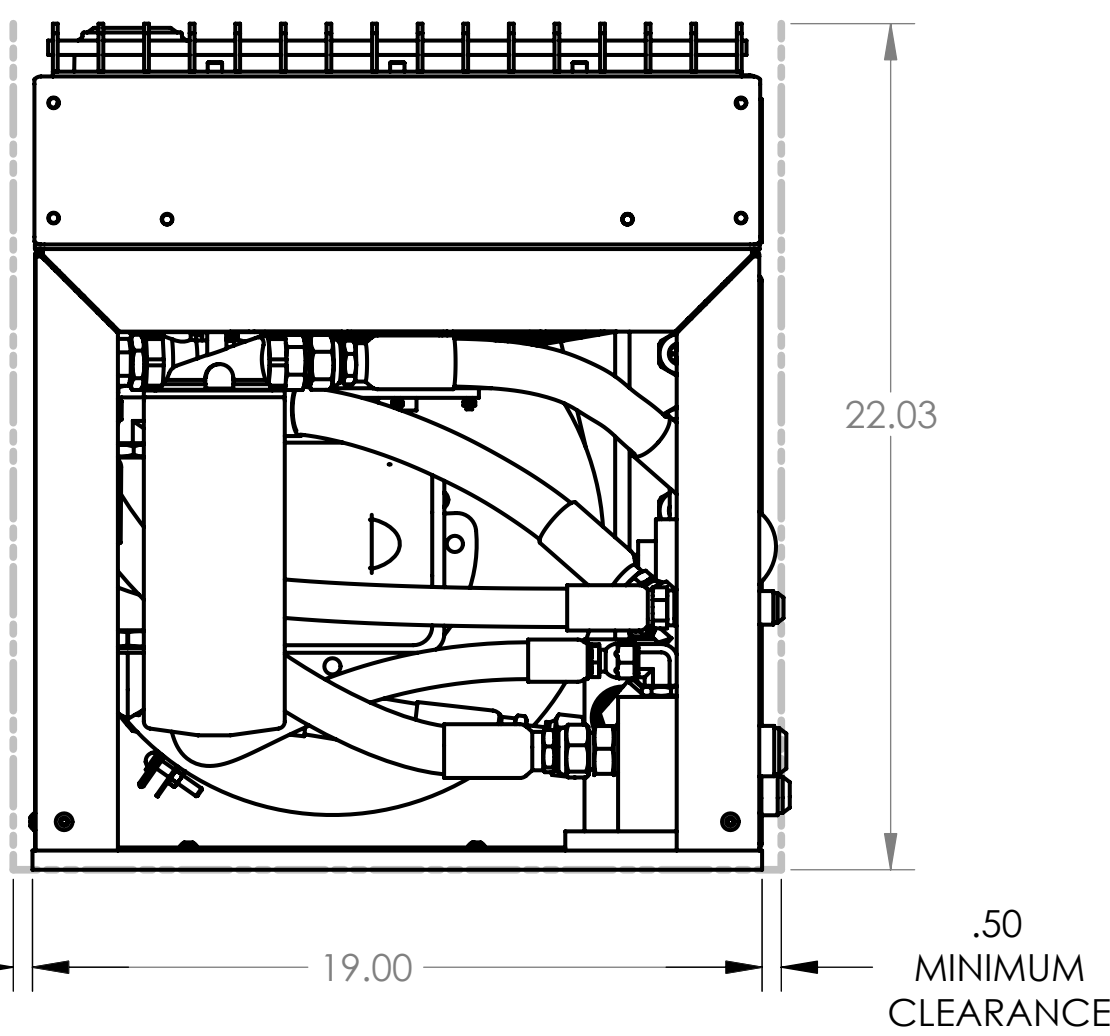

15" X 14" OPENING FOR FRESH AIR IN

- NOTE:
1. ASSEMBLY IS 100% PRODUCTION TESTED
  2. DIMENSION TOLERANCE : ±0.03
  3. RESERVOIR ASSEMBLY CAN BE REMOVED FROM FRAME ASSEMBLY AND REMOTELY MOUNTED
  4. TRAY ASSEMBLY MUST BE MOUNTED SO AS TO PREVENT RECIRCULATION OF HOT AIR EXHAUST FROM COOLER
  5. GENERATOR OUTPUT WIRE ASSEMBLY: 15FT ± 1FT LONG  
GREEN WIRE, 2AWG - GROUND  
WHITE WIRE, 2AWG - NEUTRAL  
BLACK WIRE, 2AWG - 240V, L1  
RED WIRE, 2AWG - 240V, L2  
CONDUIT, (FNMC)
  6. REF. DRAWING 26XXXXX MODEL MATRIX FOR SYSTEM DETAILS

**PROPRIETARY DATA**  
STRICTLY CONFIDENTIAL  
**NARTRON**  
CORPORATION

SW COMPUTER GRAPHICS  
NO HAND REVISIONS

THIS DOCUMENT IS THE PROPERTY OF NARTRON CORPORATION AND IS TENDERED IN CONFIDENCE FOR THE SOLE PURPOSE OF AIDING THE TRANSACTION OF BUSINESS BETWEEN NARTRON AND RECIPIENT. PERMISSION IS EXPRESSLY WITHHELD TO DISCLOSE TO OTHERS INFORMATION CONTAINED HEREIN OR TO REPRODUCE ALL OR ANY PART OF THIS DOCUMENT.

DELIVERY OF THIS DOCUMENT BY NARTRON CONVEYS NO PROPERTY RIGHTS THEREIN NOR IN ANY MANNER DISCLOSED THEREIN.

DRAWN	DATE	REQ'D	ITEM	PART NO	DESCRIPTION
DAZ	08-05-05		DO NOT SCALE		LIST OF MATERIALS
CHECKED AEB	DATE 06-09-06		DIMENSIONS ARE IN INCHES		
APPROVED PHS	DATE 06-09-06		TOLERANCE UNLESS OTHERWISE SPECIFIED		
MATERIAL		2 PLACE DECIMALS ±0.01			NAME
		3 PLACE DECIMALS ±0.005			ELECTRONIC CONTROL TRAY ASM, 30-kw TOP MOUNT
NEXT ASSEMBLY		ANGLES ±1/2°		SCALE	1/4 SIZE
		THDS. INT 2B EXT 2A		SHEET	1 OF 1
				NO	8583070



REED CITY, MI 49677